





1 CLEANOUT PLAN VIEW
Scale: N.T.S.

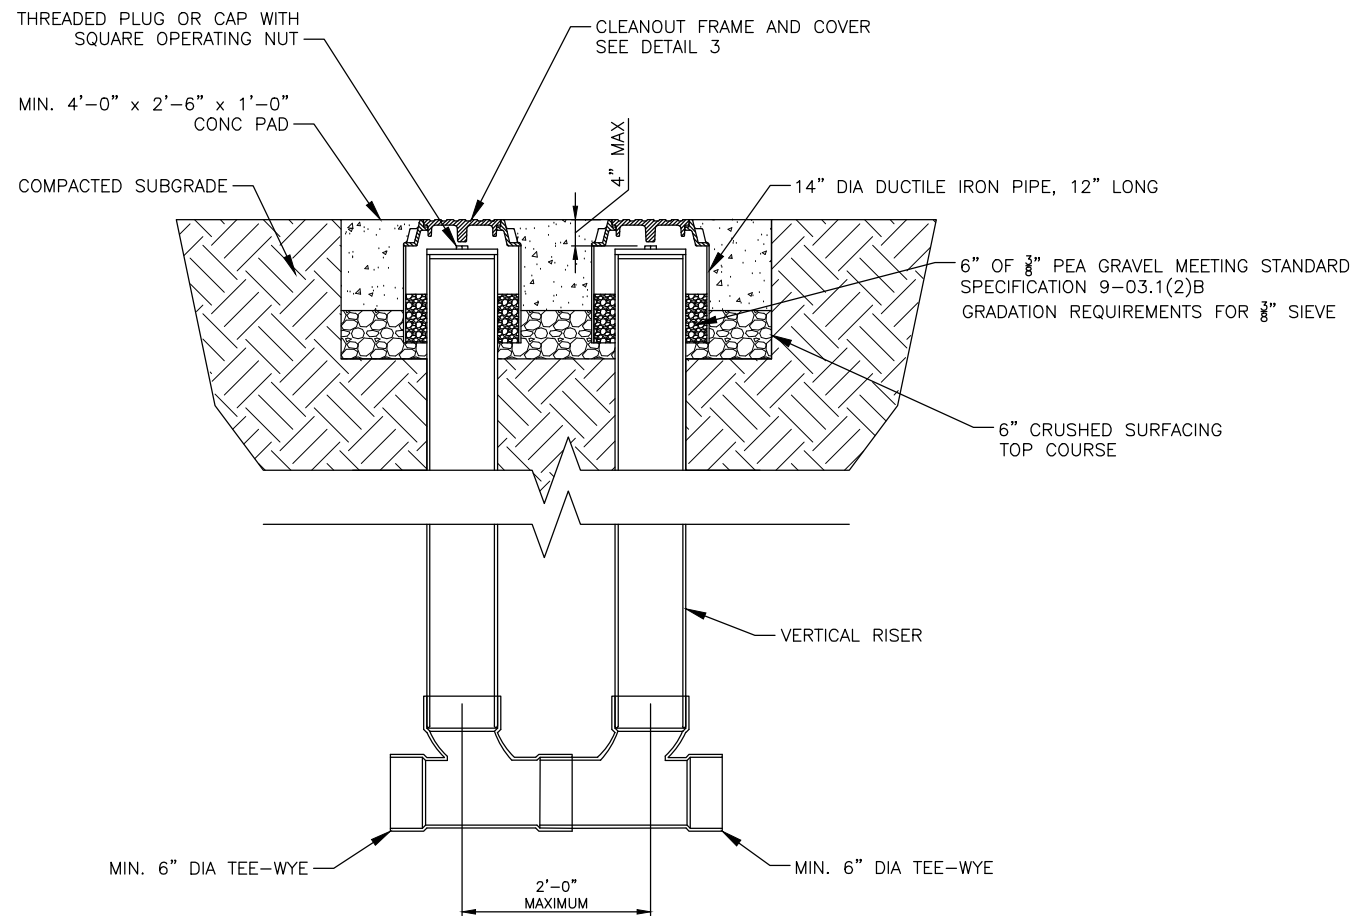

2 CLEANOUT DETAIL
Scale: N.T.S.

NOTES:

1. ALL CONNECTIONS MUST BE APPROVED BY THE CITY OF WENATCHEE AND INSTALLED PER MANUFACTURER RECOMMENDATIONS.
2. THE SANITARY SEWER LATERAL, INCLUDING THE TAP, SADDLE, TEE, PIPE, AND CLEANOUT IS CONSIDERED "PRIVATE" UPSTREAM OF THE MAIN LINE POINT OF CONNECTION.
3. MINIMUM 6" DIAMETER CLEANOUTS SHALL BE CONSTRUCTED ON ALL SEWER LATERALS. THE VERTICAL RISER SHALL BE OF EQUAL SIZE AS THE LATERAL PIPE OR LARGER.
4. CLEANOUTS MAY BE LOCATED IN THE PLANTER STRIP AT THE BACK OF WALK, IF ONE EXISTS, AND SHALL BE VISIBLE AT FINISHED GRADE. CLEANOUTS LOCATED BELOW FINISHED GRADE SHALL HAVE ACCESSIBLE COVERS.
5. CLEANOUT FRAME AND COVER SHALL BE HEAVY DUTY, BOLT DOWN EAST JORDAN MODEL 3675 OR APPROVED EQUAL AND LABELED "SEWER" OR "CLEANOUT".
6. MAXIMUM CENTER-TO-CENTER SPACING BETWEEN CLEANOUTS SHALL BE 2'-0". MODIFICATIONS TO THIS SPACING REQUIRE THE APPROVAL OF THE ENGINEER.
7. CONCRETE PAD FC' SHALL BE 3,000 PSI OR GREATER.
8. ALL #4 REBAR SHALL HAVE 2" MINIMUM COVER.

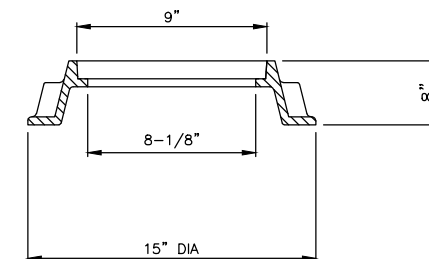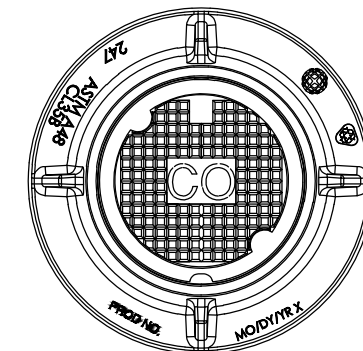

3 CLEANOUT FRAME AND COVER
Scale: N.T.S.

**STANDARD DETAIL
SANITARY SEWER
DOUBLE CLEANOUT**



SCALE: AS SHOWN	DATE DRAWN	REVISIONS		DATE	INITIAL
		DESIGNED	DRAWN		
SRD	3/9/2020				
APPROVED BY	CHECKED				
	DATE APPROVED				
STANDARD SPECIFICATIONS WSDOT 7-08 GENERAL PIPE INSTALLATION WSDOT 7-18 SIDE SEWERS WSDOT 7-19 SEWER CLEANOUTS					

DETAIL NO.
S-120

PAGE
1 OF 1